

SPECIFICATION:

SPECIFY THE LIGHTING STATION ABOVE THE BATHROOM VANITY. THE TOP OF THE FIXTURE SHOULD BE A MINIMUM OF 6'6" OFF THE FINISHED FLOOR TO ACCOMMODATE THE HEIGHT OF A HOTEL GUEST.

THE MC CABLE IS BROUGHT IN THROUGH THE CHASSIS KNOCKOUT AND CONNECTED TO TERMINAL CONNECTOR. NO ELECTRICAL BOX REQUIRED. ELECTRICAL POWER SHOULD BE CONTROLLED BY A LIGHT SWITCH. 120 OR 240 VOLT VERSIONS.

FIXTURE SHOULD BE MOUNTED TO A MECHANICALLY SOUND SURFACE SUCH AS WALL STUDS TO SUPPORT ITS WEIGHT. MOUNTING HOLES ARE PROVIDED IN THE CHASSIS.

POWER REQUIREMENTS:

120 VOLTS, 1.8 AMPS

LAMP SPECIFICATION:

NOMINAL LENGTH (in): 48
 NOMINAL WATTAGE: 54
 BULB: 4 X T5HO
 AVG RATED LIFE (hrs): 20000
 CCT (K): 3000
 LUMENS: 4200
 CRI: 82

ELECTRIC MIRROR[®] 2007
 HOTEL LUXURY


SILHOUETTE-53.00X53.00

SALES AID- 01-15-08

PROPRIETARY AND CONFIDENTIAL:

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF ELECTRIC MIRROR L.L.C. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF ELECTRIC MIRROR L.L.C. IS PROHIBITED. COPYRIGHT 2007.

DIMS IN INCHES	REV. B
SCALE: 1:20	PG.1 OF 2

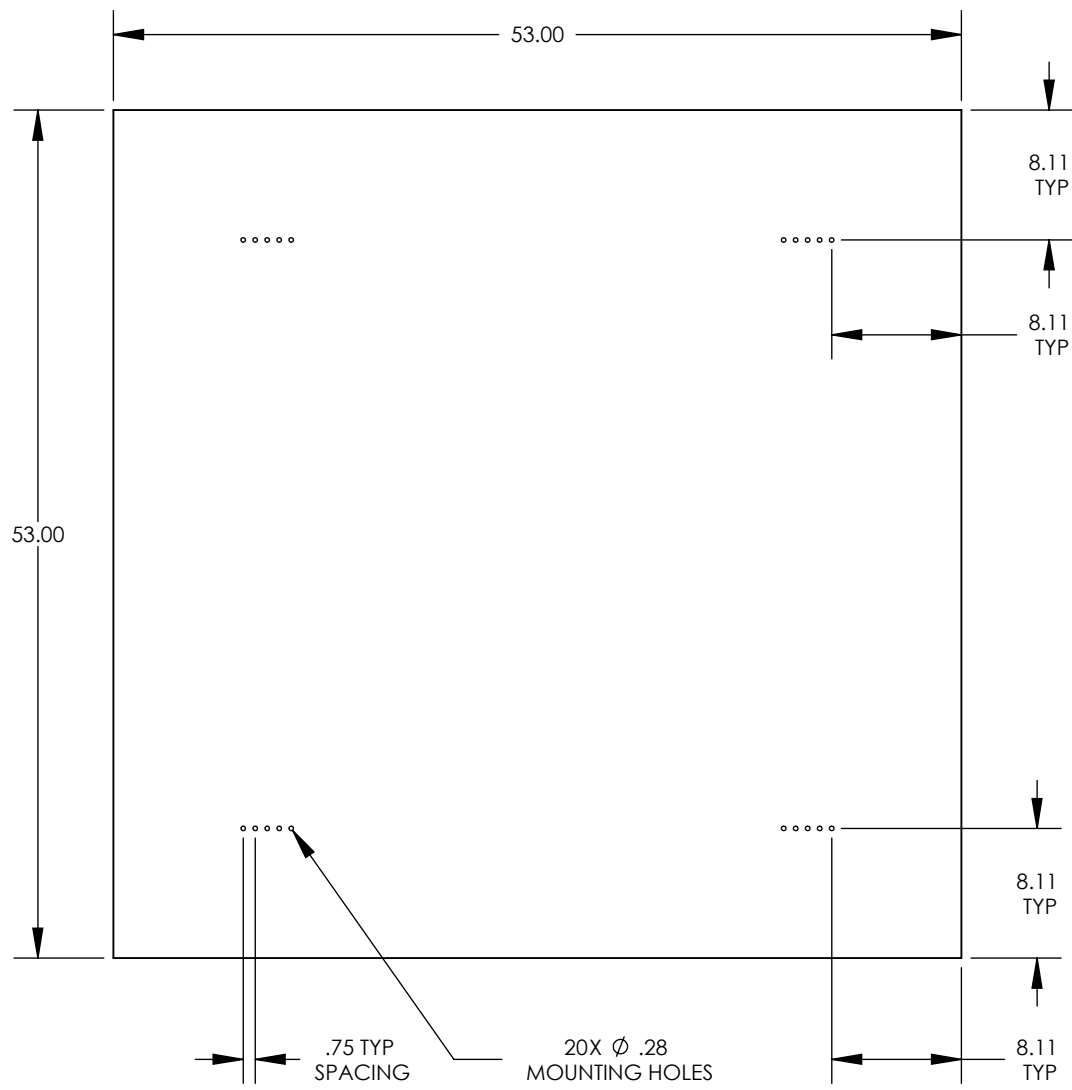

ELECTRIC MIRROR[®] 2008
HOTEL LUXURY

SALES AID- 01-16-08

PROPRIETARY AND CONFIDENTIAL:

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF ELECTRIC MIRROR L.L.C. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF ELECTRIC MIRROR L.L.C. IS PROHIBITED. COPYRIGHT 2008.

DIMS IN INCHES	REV. B
SCALE: 1:12	PG.2 OF 2